


With Honeywell UDC 230G Controller
 And Honeywell UDC 230L High Limit, With SCR. and Bell

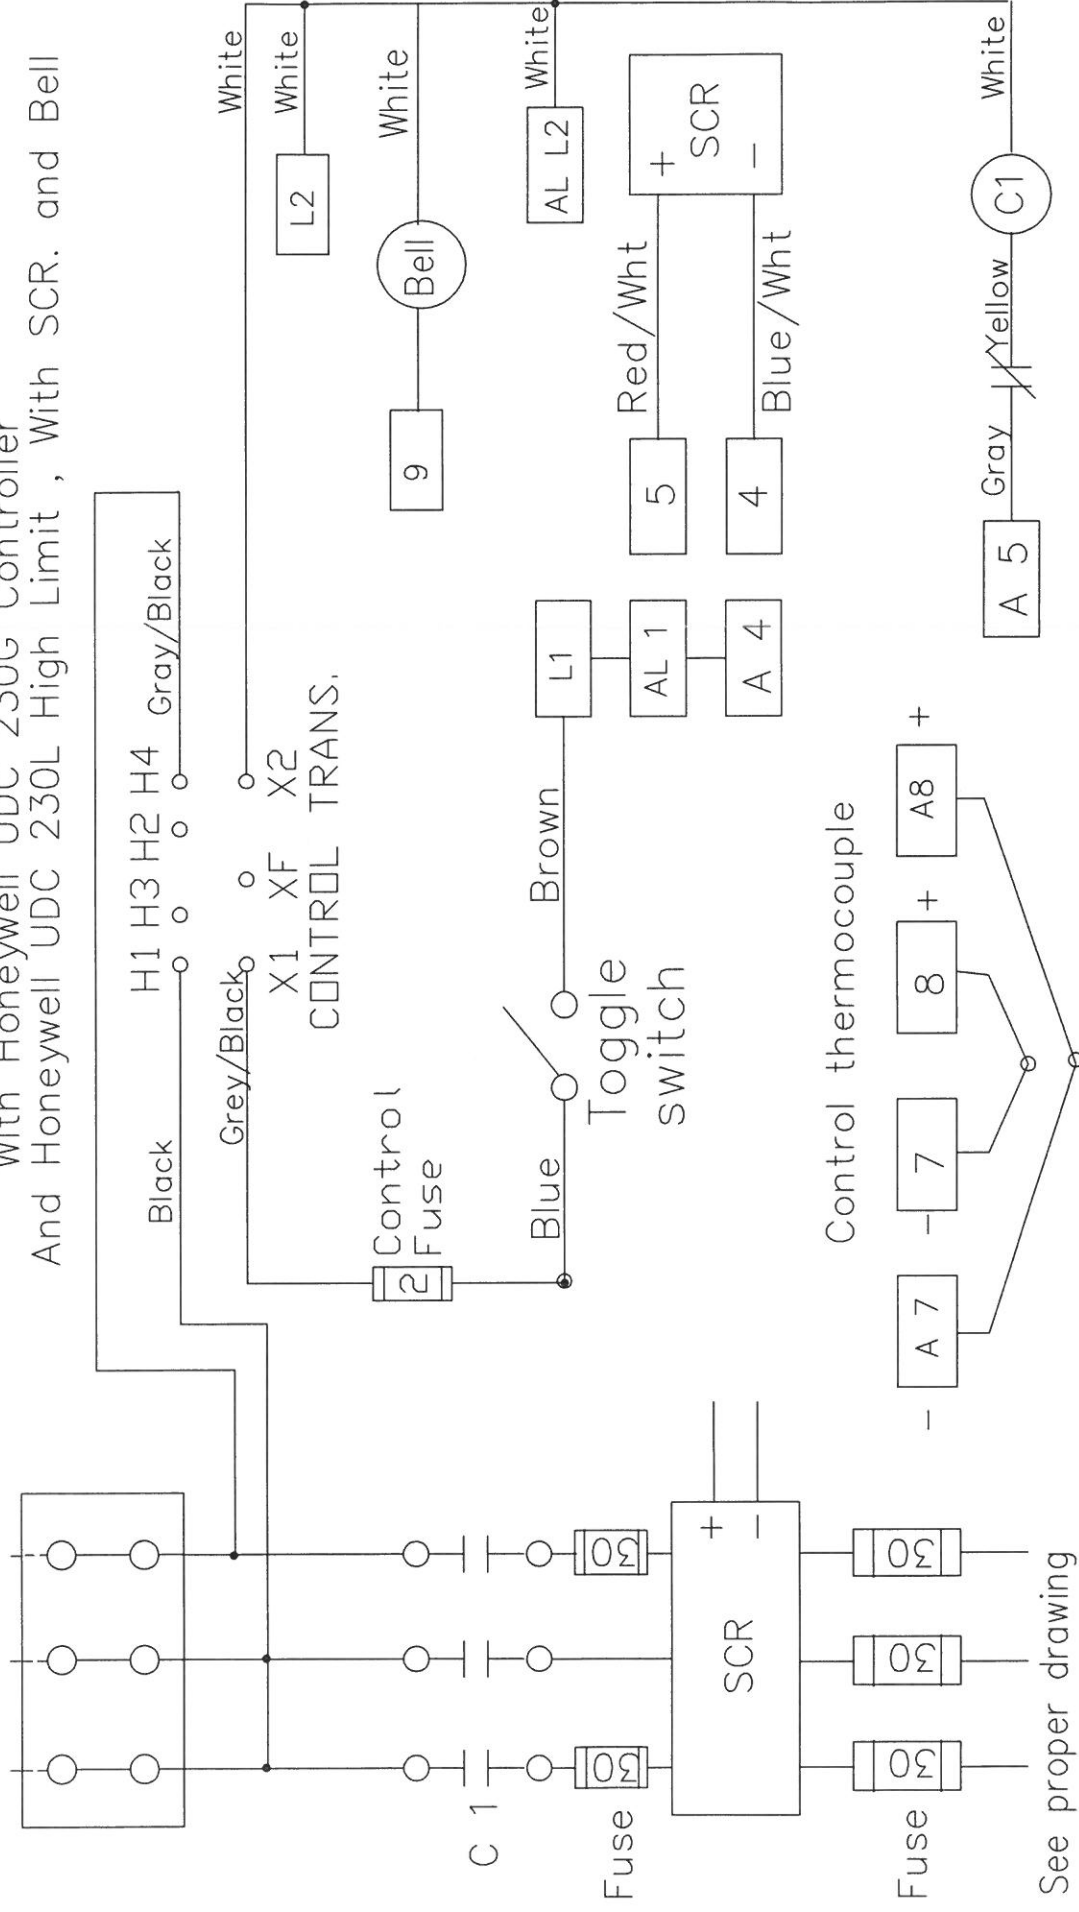

See proper drawing
 for panel connections
 according to voltage.
 Heating Elements

-  Control Inst. Term.
-  Contactor Coils
-  High Limit Terminals
-  Holding Relay

Equipment Grounding
 Green

ED0093